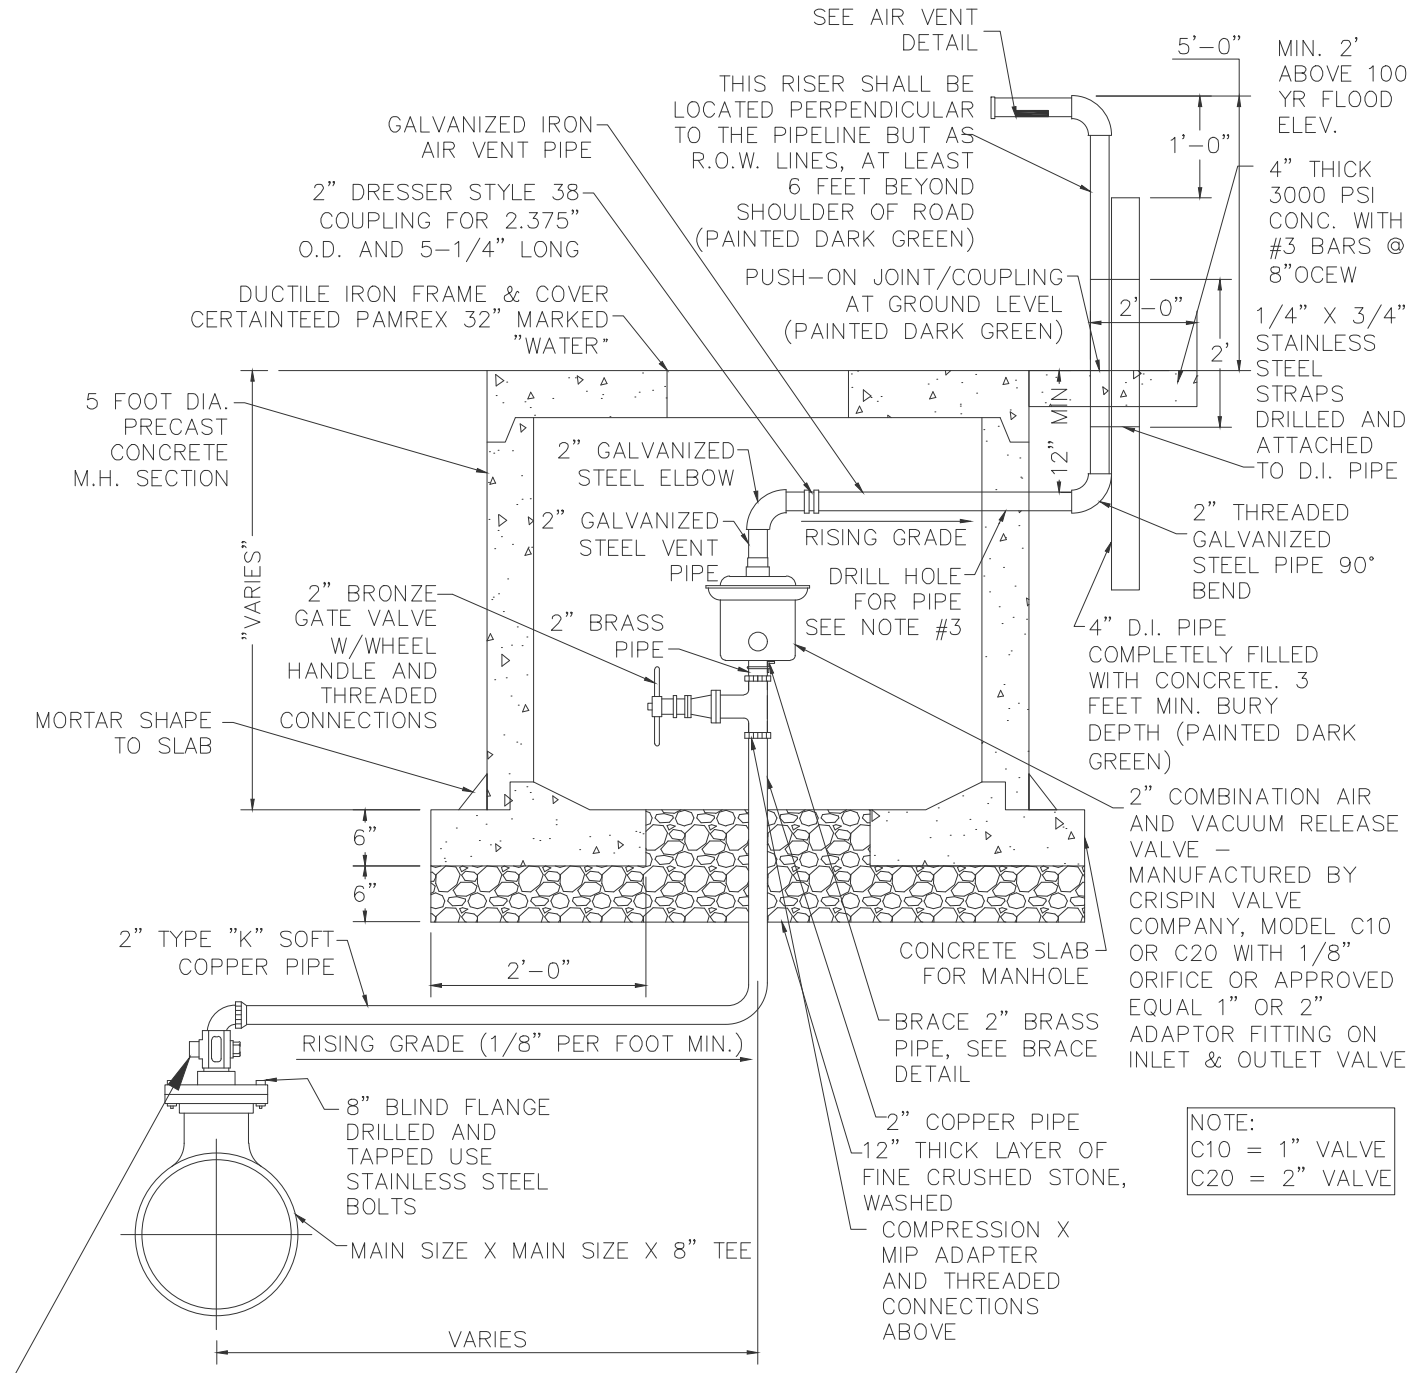

NOTE:
C10 = 1" VALVE
C20 = 2" VALVE

AIR RELEASE VALVE (IN)	PIPE SIZE (IN)
1"	6" - 12"
2"	16" - 24"
3"	30" - 36"
4"	UP TO 48"

City of KELLER

WATER CONSTRUCTION DETAILS

STANDARD COMBINATION AIR VALVE AND VAULT

REVISION DATE: 2/1/2024

SHEET: W-17