


ITEM NO.	QTY	SIZE	DESCRIPTION	PART NUMBER		
				RDMAC	FORD	MUELLER
1.	1	1"	BALL ANGLE SERVICE VALVE COMPRESSION COPPER X F.I.P.	—	BA41-444WG	B-24274-N
2.	1	1" x 3/4" x 7 1/2"	U-BRANCH	-	U88-43	H 15364
3.	2	3/4"	BALLVALVE CB. STOP, F.I.P. X SWIVEL METER NUT	-	B13-332W	B24351
4.	2	3/4" x 8-1/2"	STRAIGHT METER COUPLING	-	C38-44-1-5 -NL	H-14217-N
5.	2	1" x 7-1/2"	METER SPACER NIPPLE (SCH 80 PVC) SEE NOTE #2	-	-	-
6.	1	1"	IRON SADDLE WITH DOUBLE WIDE STAINLESS STEEL BAND	202S	C202-CC4	DR2A-3235

* METER BOXES FOR DOUBLE WATER SERVICES SHALL BE DFW PLASTICS #DFW38C-14-AF1F DEEP

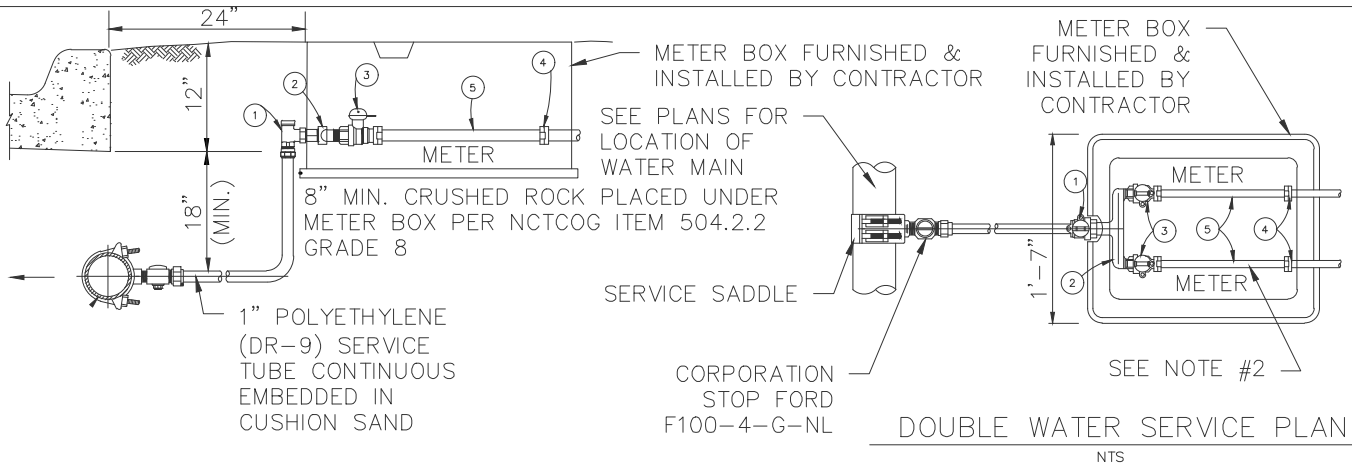


DOUBLE WATER SERVICE SECTION

NTS

NOTES:

1. ALL BRASS PARTS SHALL BE "LEAD-FREE" AS REQUIRED BY E.P.A. REGULATIONS.
2. CONTRACTOR SHALL PERFORATE METER SPACER NIPPLES AS DIRECTED BY INSPECTOR.
3. RECESSED AMR HOLE IN METER BOX SHALL BE PLACED NEAREST TO THE BACK OF CURB.
4. SERVICES ALONG ROADWAYS WITHOUT CURB AND GUTTER SHALL BE LOCATED A MINIMUM OF 18" BELOW THE DITCH FLOWLINE.
5. SERVICE LINES CROSSING UNDER THE ROADWAY SHALL BE LOCATED A MINIMUM OF 30" BELOW GRADE AND ENCASED WITH 2" SCHEDULED 40 PVC PIPE.
6. WATER SERVICES SHALL NOT BE CONNECTED TO FIRE HYDRANT LEADS.
7. METERS SHALL NOT BE INSTALLED IN EXISTING OR PROPOSED SIDEWALKS OR WITHIN 5' OF DRIVEWAYS.
8. DOUBLE WATER SERVICES SHALL ONLY BE INSTALLED ON THE PROPERTY LINE SERVING ADJACENT PROPERTIES DOMESTIC USE.
9. IRRIGATION METERS SHALL REQUIRE SINGLE WATER SERVICE (SEE DETAIL W-20).

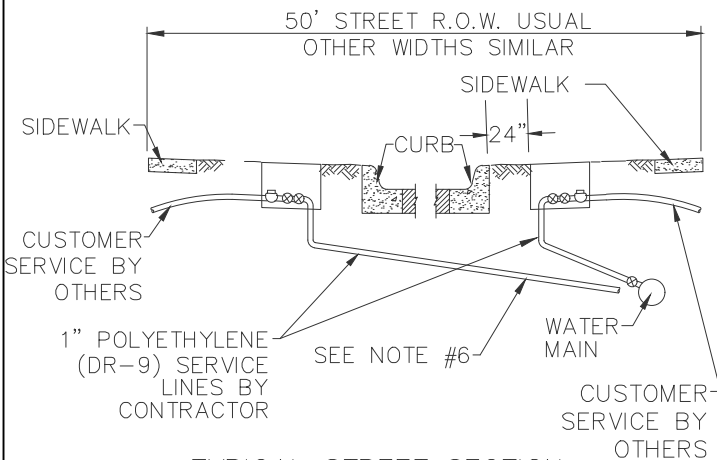

TYPICAL STREET SECTION

NTS



WATER CONSTRUCTION DETAILS
DOUBLE WATER SERVICE ASSEMBLY

REVISION DATE:
2/1/2024

SHEET: W-19