


ELEVATION VIEW

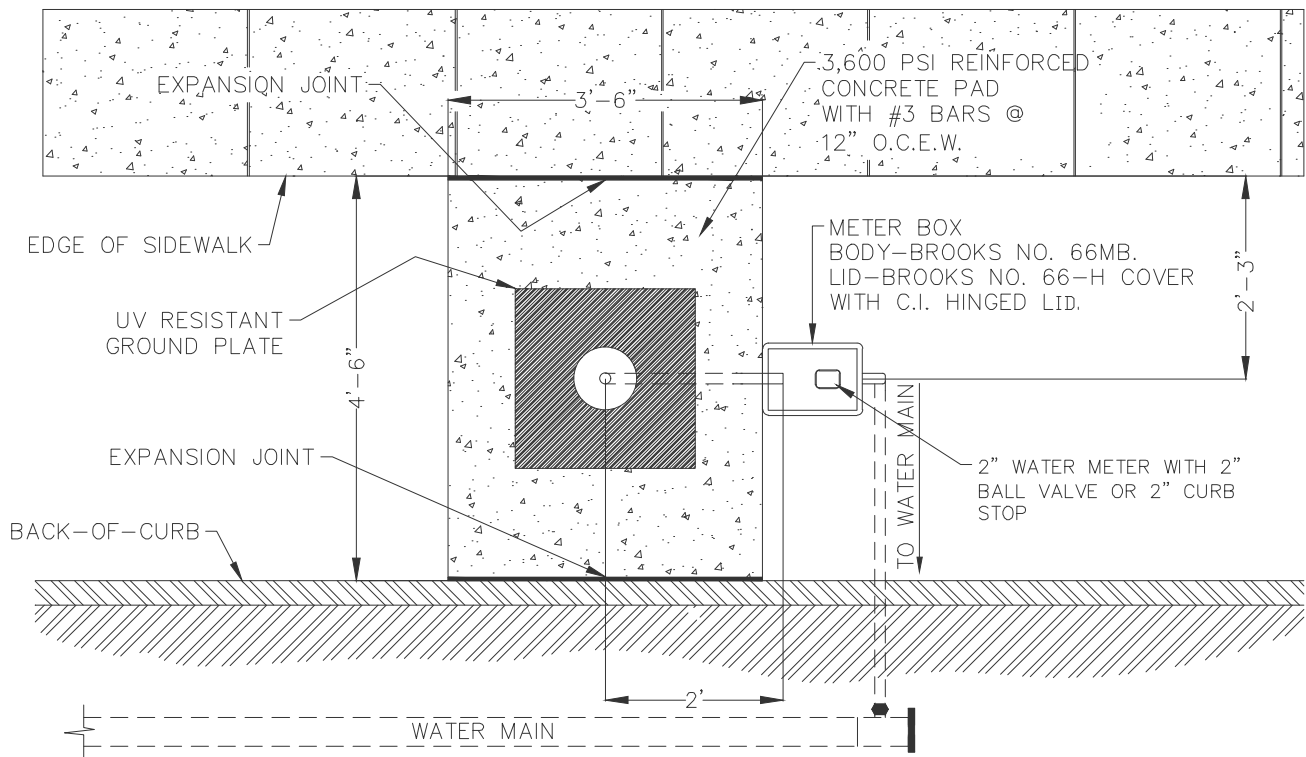

PLAN VIEW

NOTES:

1. EMBEDMENT FROM MAIN TO CURB VALVE SHALL MEET STANDARD CITY EMBEDMENT REQUIREMENTS.
2. BACKFILL TO BE COMPACTED IN 6" LIFTS.
3. TRACER WIRE SHALL BE 10 AWG HDPE COATED SINGLE STRAND COPPER CLAD STEEL TO BE INSTALLED CONTINUOUSLY (NO SPLICING ALLOWED) FROM THE WATER MAIN TO THE METER BOX.



WATER CONSTRUCTION DETAILS  
AUTOMATIC FLUSHING VALVE

REVISION DATE:  
2/1/2024

SHEET: W-21