



PLAN VIEW  
N.T.S.

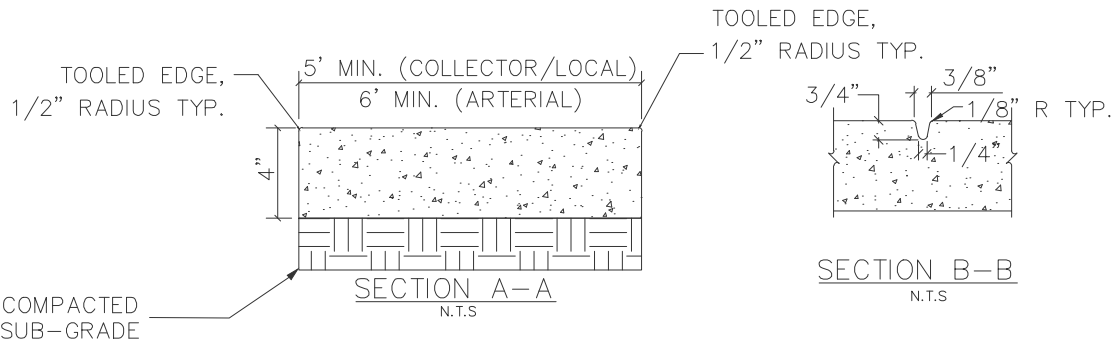


SECTION A-A  
N.T.S.

SECTION B-B  
N.T.S.

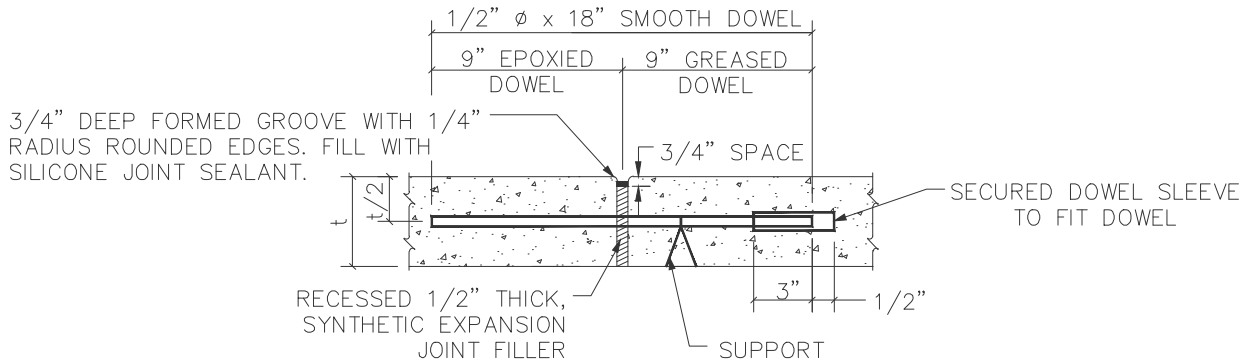

SECTION C-C  
N.T.S.

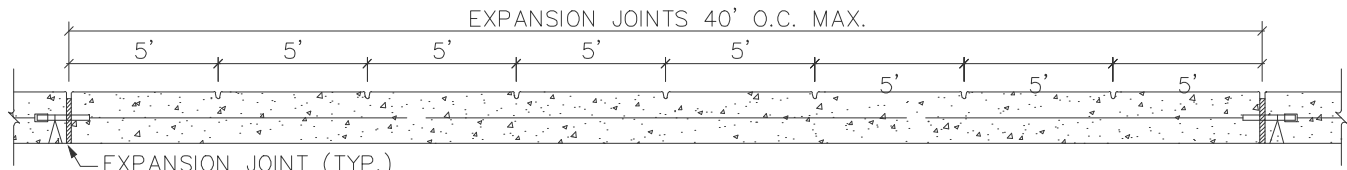

SECTION D-D  
N.T.S.

- NOTE:**
1. REINFORCEMENT TO BE #3 BARS AT 18" O.C.E.W.
  2. DOWEL WITH #4 BARS AT 18" C-C WHEN CONNECTING TO EXISTING SIDEWALKS, DRIVEWAYS, CURBS AND GUTTER - MINIMUM PENETRATION 6".
  3. INSTALL 1/2"  $\phi$  X 18" SMOOTH DOWELS @ 18" (GREASE ONE END & CAP) THROUGH EXPANSION JOINTS.
  4. CONCRETE FOR SIDEWALKS SHALL BE CLASS C 3600 PSI.
  5. ALL PROPOSED VALVES SHALL BE PLACED AT LEAST ONE FOOT OFF THE EDGE OF THE SIDEWALK. PROPOSED MANHOLES SHALL HAVE LIDS CENTERED IN THE SIDEWALK OR BLOCK OUT EXISTING VALVES/MANHOLES.
  6. SIDEWALK CROSS SLOPE 1/4"/FT (TYPICAL) MAX.
  7. EXPANSION JOINTS TO BE RECESSED 3/4" AND FILLED WITH SILICONE SEALANT.
  8. IF SIDEWALK IS LESS THAN 60" WIDE, A "PASSING SPACE" AT INTERVALS OF 200 FT SHALL BE PROVIDED. PASSING SPACE MUST BE 60" (MIN) BY 6" (MIN)



**PAVING CONSTRUCTION DETAILS**  
**CONCRETE SIDEWALK**

REVISION DATE:  
2/1/2024

SHEET: P-15