


DROP INLET PROTECTION

N.T.S.

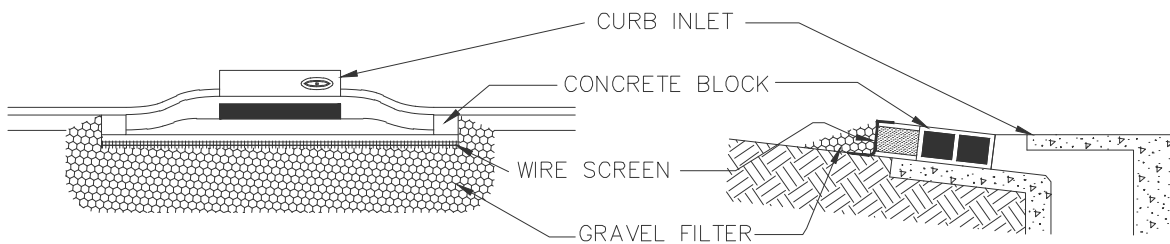

INLET PROTECTION—BLOCK AND GRAVEL

N.T.S.

INLET PROTECTION NOTES:

1. PLACE CONCRETE BLOCKS IN A SINGLE ROW AROUND PERIMETER OF INLET ON THEIR SIDES, WITH ENDS OF ADJACENT BLOCKS ABUTTING.
2. HEIGHT OF BARRIER VARIES. USE STACKS OF 4-INCH, 8-INCH, OR 12-INCH BLOCKS. MIN. HEIGHT OF BARRIER IS 12" AND MAX HEIGHT IS 24".
3. PLACE HARDWARE CLOTH/WIRE MESH WITH MAX. 1/2" OPENINGS OVER VERTICAL FACE OF CONCRETE BLOCKS.
4. THE SEDIMENT FILTER SHALL BE ANY NON-ERODIBLE MATERIAL SUCH AS LOOSE ROCK OR BROKEN CONCRETE THAT WILL SLOW THE FLOW OF WATER AND ALLOW IT TO FILTER THROUGH AND OVER THE MATERIAL BEFORE ENTERING THE INLET.



EROSION CONTROL DETAILS
INLET PROTECTION

REVISION DATE:
2/1/2024

SHEET: E-04